



*NOTE - A minimum 38mm ventilation cavity is required for a baffle jointed system.

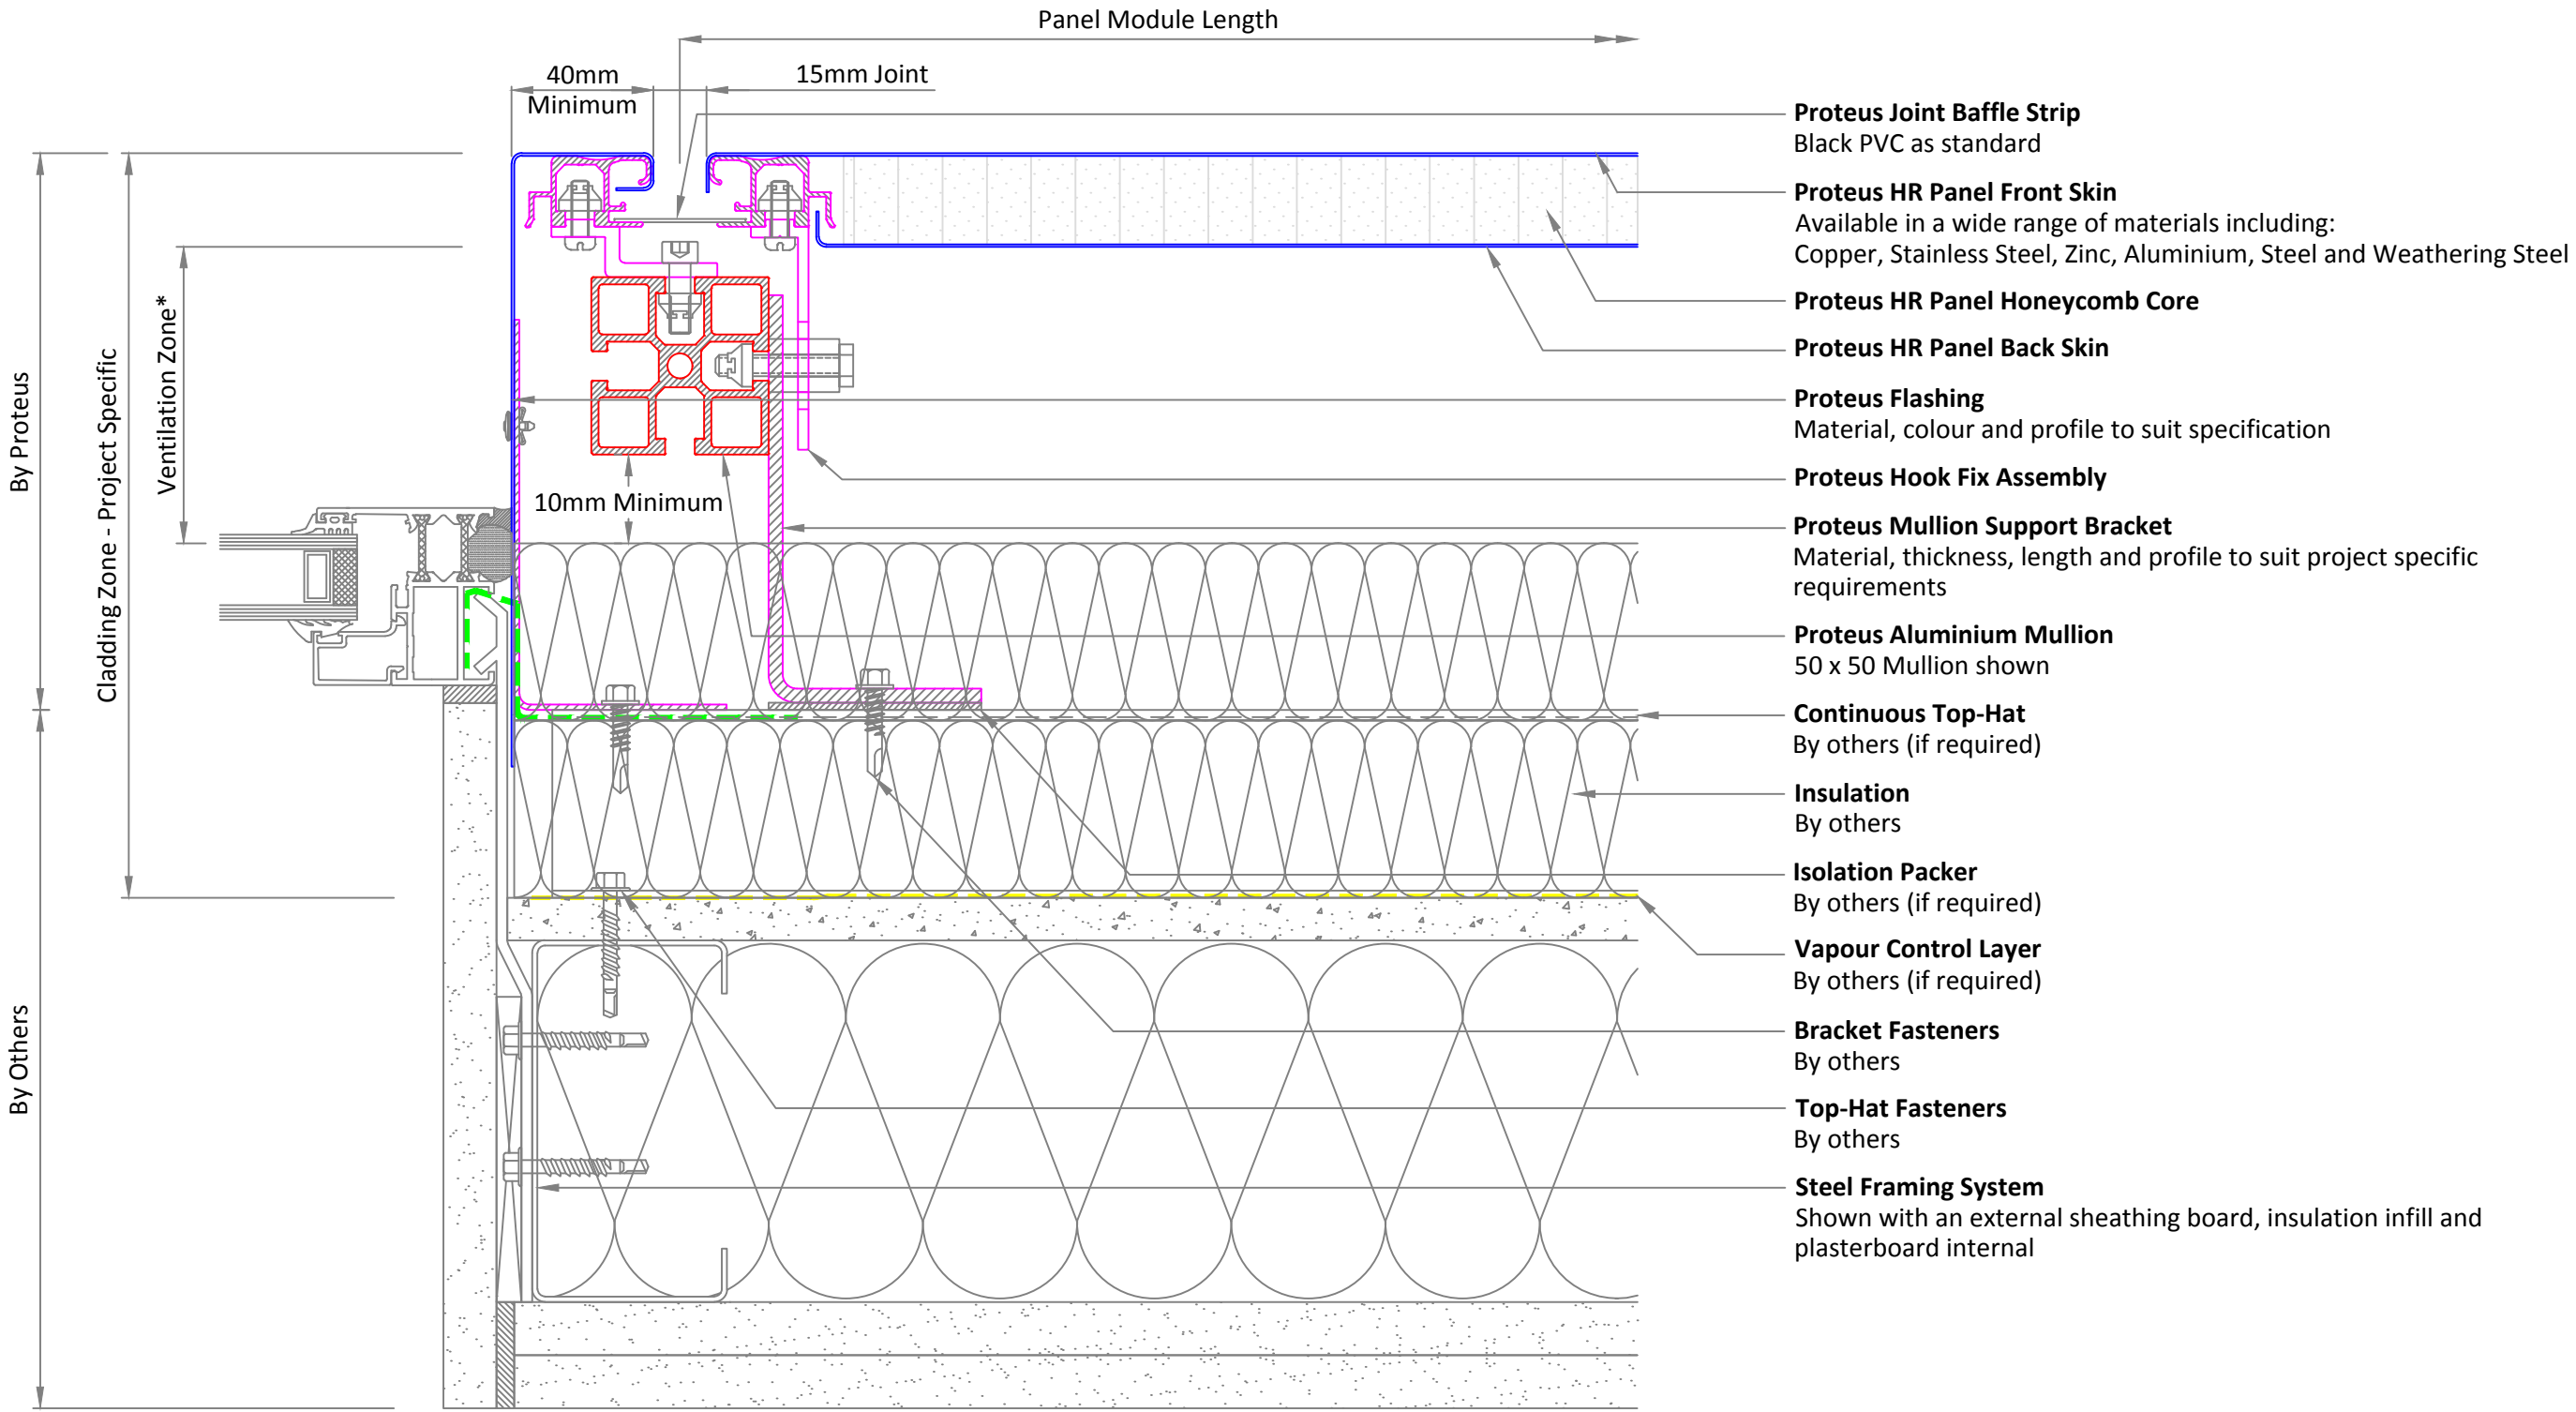

<div>Revision</div>	<div>Date</div>	<div>Amendment</div>	<div>Drawn</div>	<div><div><div>ENGINEERED FACADE TECHNOLOGY</div><div>1 Gerrard Place Skelmersdale Lancashire WN8 9SU United Kingdom</div><div>Tel No: +44 (0) 151 545 5075 E-mail: info@proteusfacades.com</div></div></div>	<div>All copyright and design right contained within this document is the property of Proteus and may not be reproduced without the written consent of Proteus.</div>	System <div>Proteus HR</div>				
						Title <div>Panel to Window Jamb (Recessed)</div>				
						Section <div>Horizontal</div>	Structure <div>SFS</div>	Panel Type <div>Flat</div>	Carrier <div>50x50</div>	Fixing Type <div>Mixed</div>
						Drawn By <div>RJ</div>	Drawn Date <div>Oct 11</div>	Approved By <div>SRG</div>	Approval Date <div>21.01.19</div>	Scale <div>1:2</div>
						Proteus reference no. <div>HR-007</div>			Drawing Size <div>A3</div>	Revision <div>D</div>