
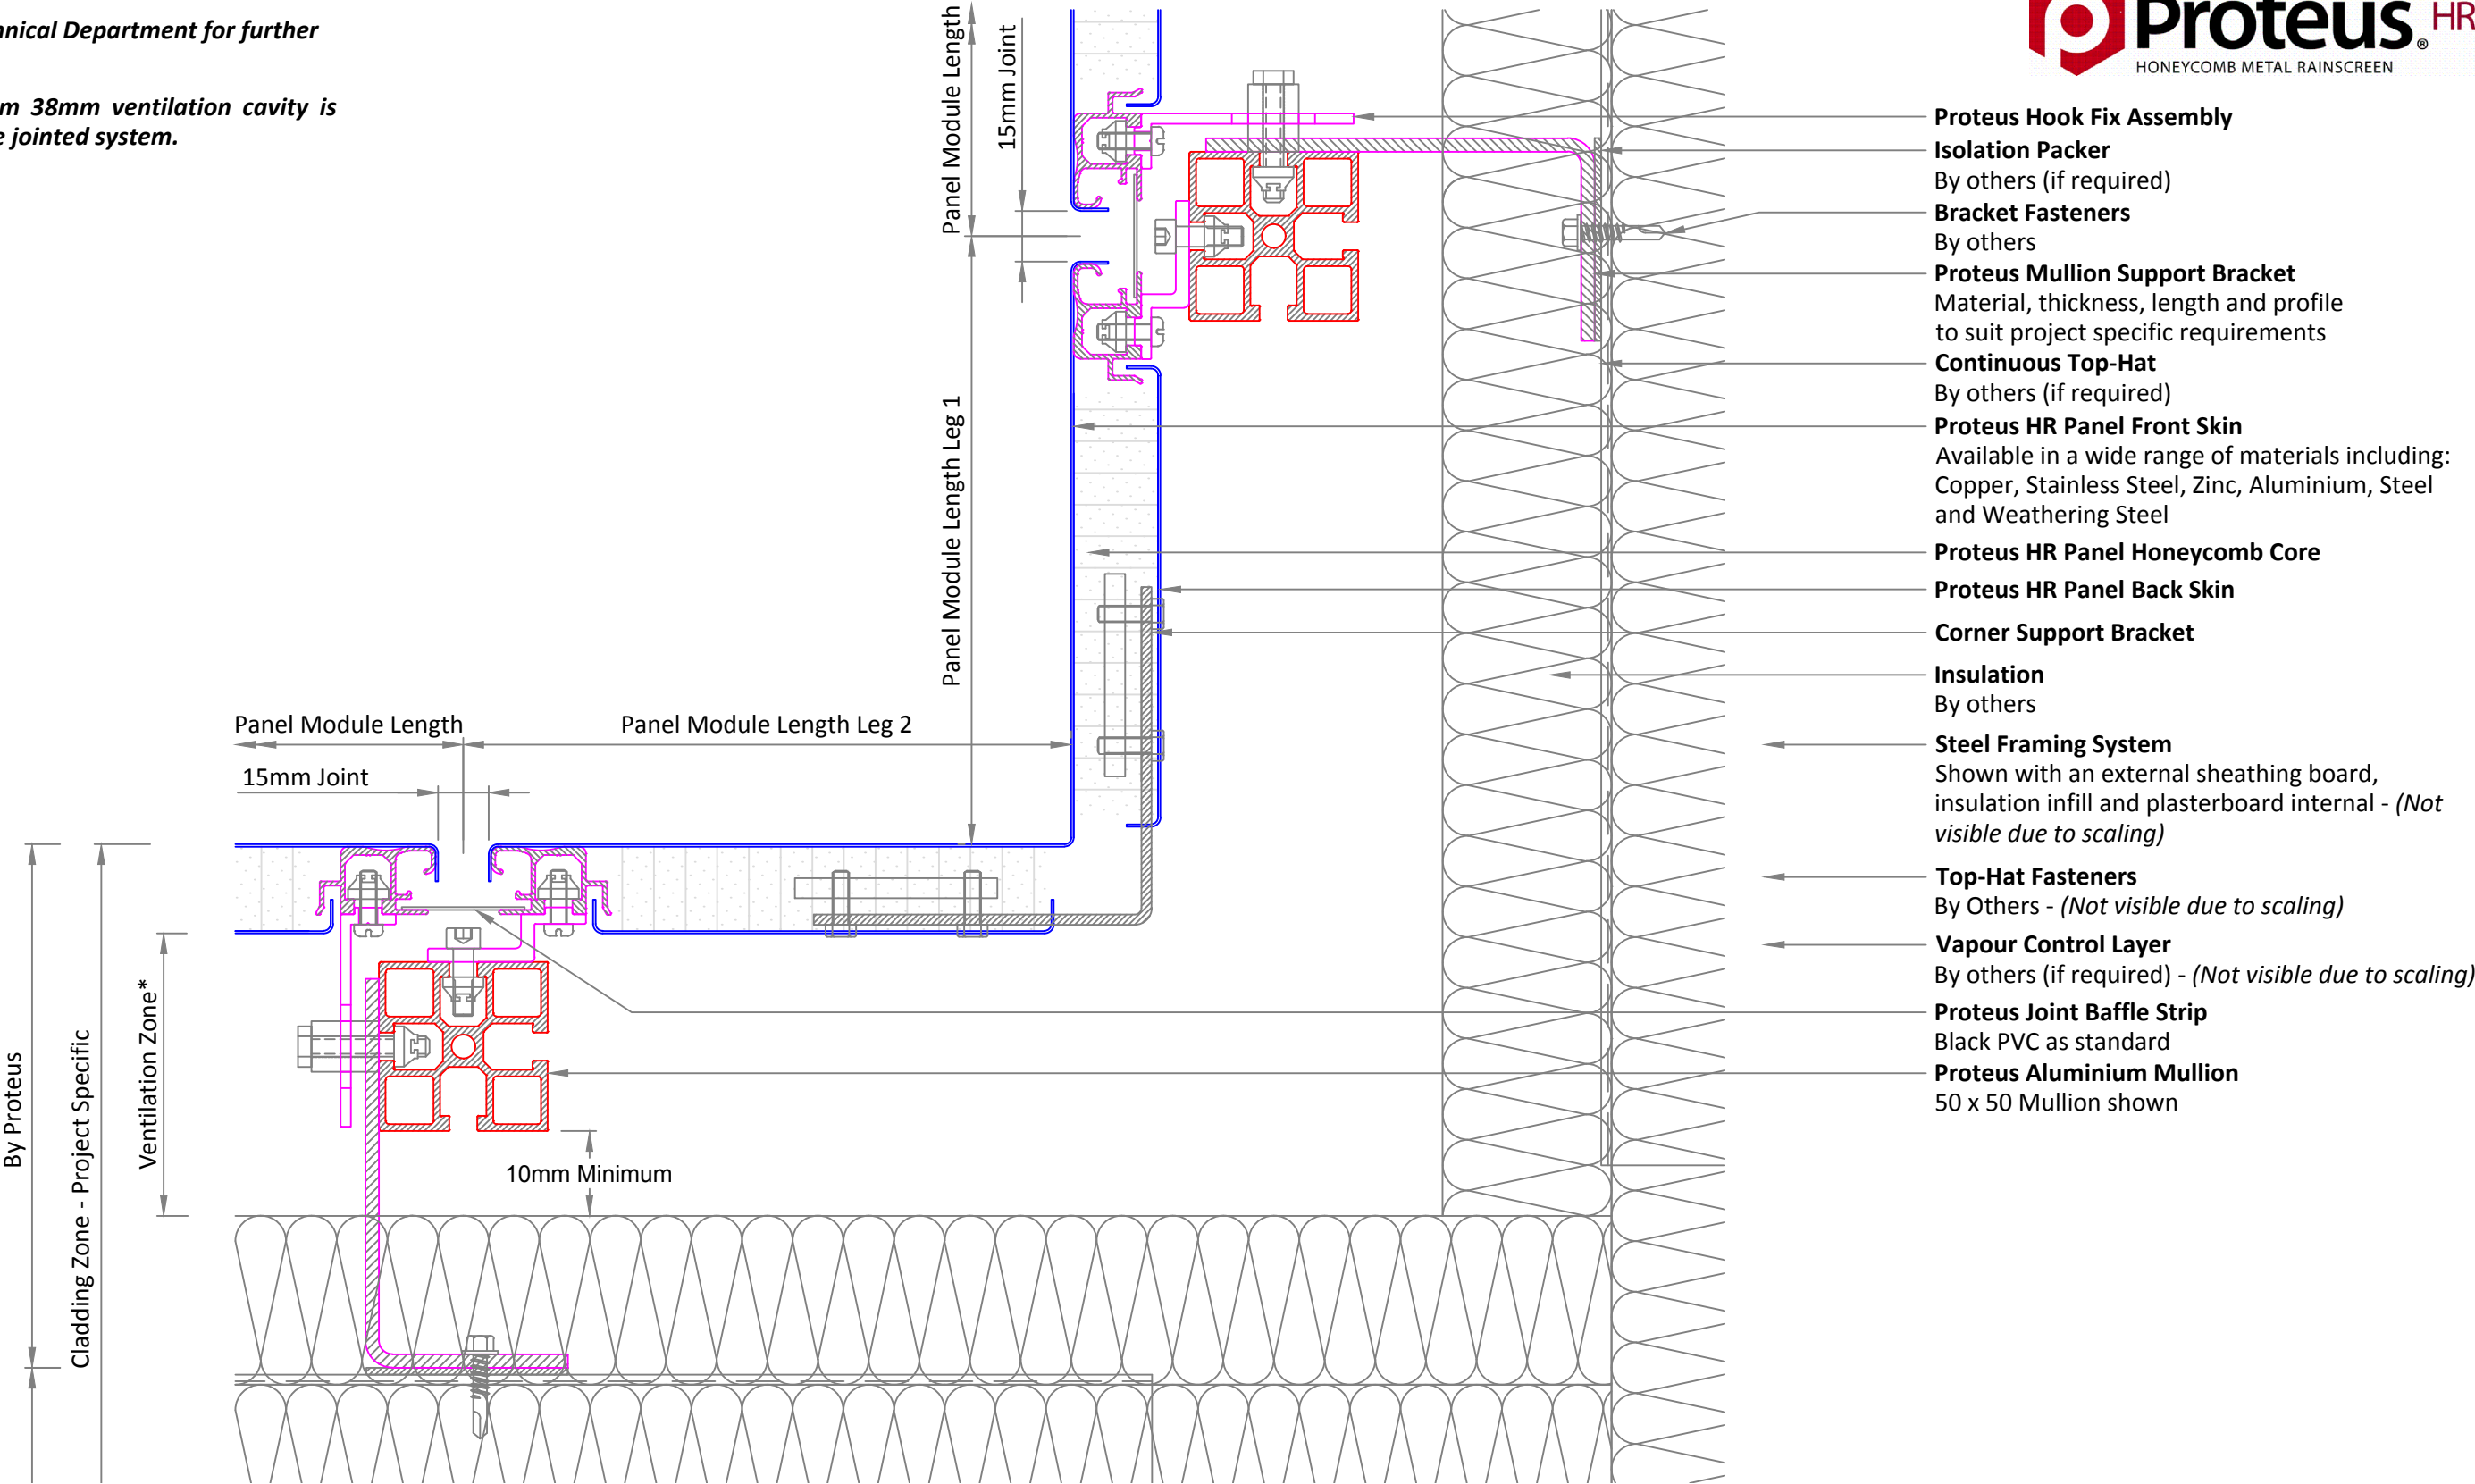



*NOTE - If a panel leg (or legs) exceed 500mm, a midspan support will be required.

Please contact Technical Department for further information.

*NOTE - A minimum 38mm ventilation cavity is required for a baffle jointed system.

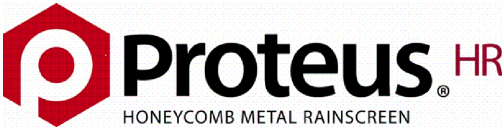

C B A	04.09.18	General Updates	AF LK RJ	<div>Proteus ENGINEERED FACADE TECHNOLOGY</div> <div>1 Gerrard Place Skelmersdale Lancashire WN8 9SU United Kingdom</div> <div>Tel No: +44 (0) 151 545 5075 E-mail: info@proteusfacades.com</div>	All copyright and design right contained within this document is the property of Proteus and may not be reproduced without the written consent of Proteus.	System Proteus HR				
	26.07.17	Added Insulation Layer				Title Internal Corner Panel to Panel				
	04.03.14	Single fold/Top-hat				Section Horizontal	Structure SFS	Panel Type Flat	Carrier 50x50	Fixing Type Mixed
						Drawn By RJ	Drawn Date Oct 11	Approved By SRG	Approved Date 21.01.19	Scale 1:2
Revision	Date	Amendment	Drawn		DO NOT SCALE FROM THIS DRAWING	Proteus reference no. HR-006		Drawing Size A3	Revision C	